

LARGEST SEWER SIZE	A
UP TO 21"	4'-0"
OVER 21"	5'-0" *





NOTE:
MANHOLE SECTIONS SHALL CONFORM TO ASTM C 478.
UTILIZING 4,000 PSI CONCRETE WITH PENTON
ADMIXTURE. JOINTS SHALL CONFORM TO ASTM C 443.

* IN GENERAL, ONLY THE BOTTOM 8 FEET OF THE MANHOLE.
TRANSITION FROM 5 FEET AND LARGER DIAMETER CAST
SECTIONS TO 4 FEET BARREL SECTIONS AND/OR CASTING
SHALL BE THROUGH USE OF 1 OR MORE CONE SECTIONS.

CORE DRILL
CONNECTOR OR
ENGINEER APPROVE

MANHOLE CASTING TABLE		
LOCATION	MODEL	COVER
18" INCHES OR MORE ABOVE 100 YEAR FLOOD ELEVATION OF ALL WATERWAYS	EAST JORDAN FRAME 105021 (PN: #00105018) LID 1020AGS (PN: #00102119)	TRAFFIC RATED
LESS THAN 18" ABOVE 100 YEAR FLOOD ELEVATION OF ALL WATERWAYS	EAST JORDAN 105021PPT ASSEMBLY (PN: #00102119w01) FRAME 10502107 (PN: #00105022) LID 1020APT (PN: #00102072)	TRAFFIC RATED
LID		
OWNERSHIP	LETTERING	
HAMILTON SOUTHEASTERN UTILITIES, INC.	"SANITARY SEWER - HSE"	
PRIVATE	"SANITARY SEWER"	

ALL CASTINGS TO BE SUPPLIED WITH
FOUR (4) ANCHOR BOLT HOLES

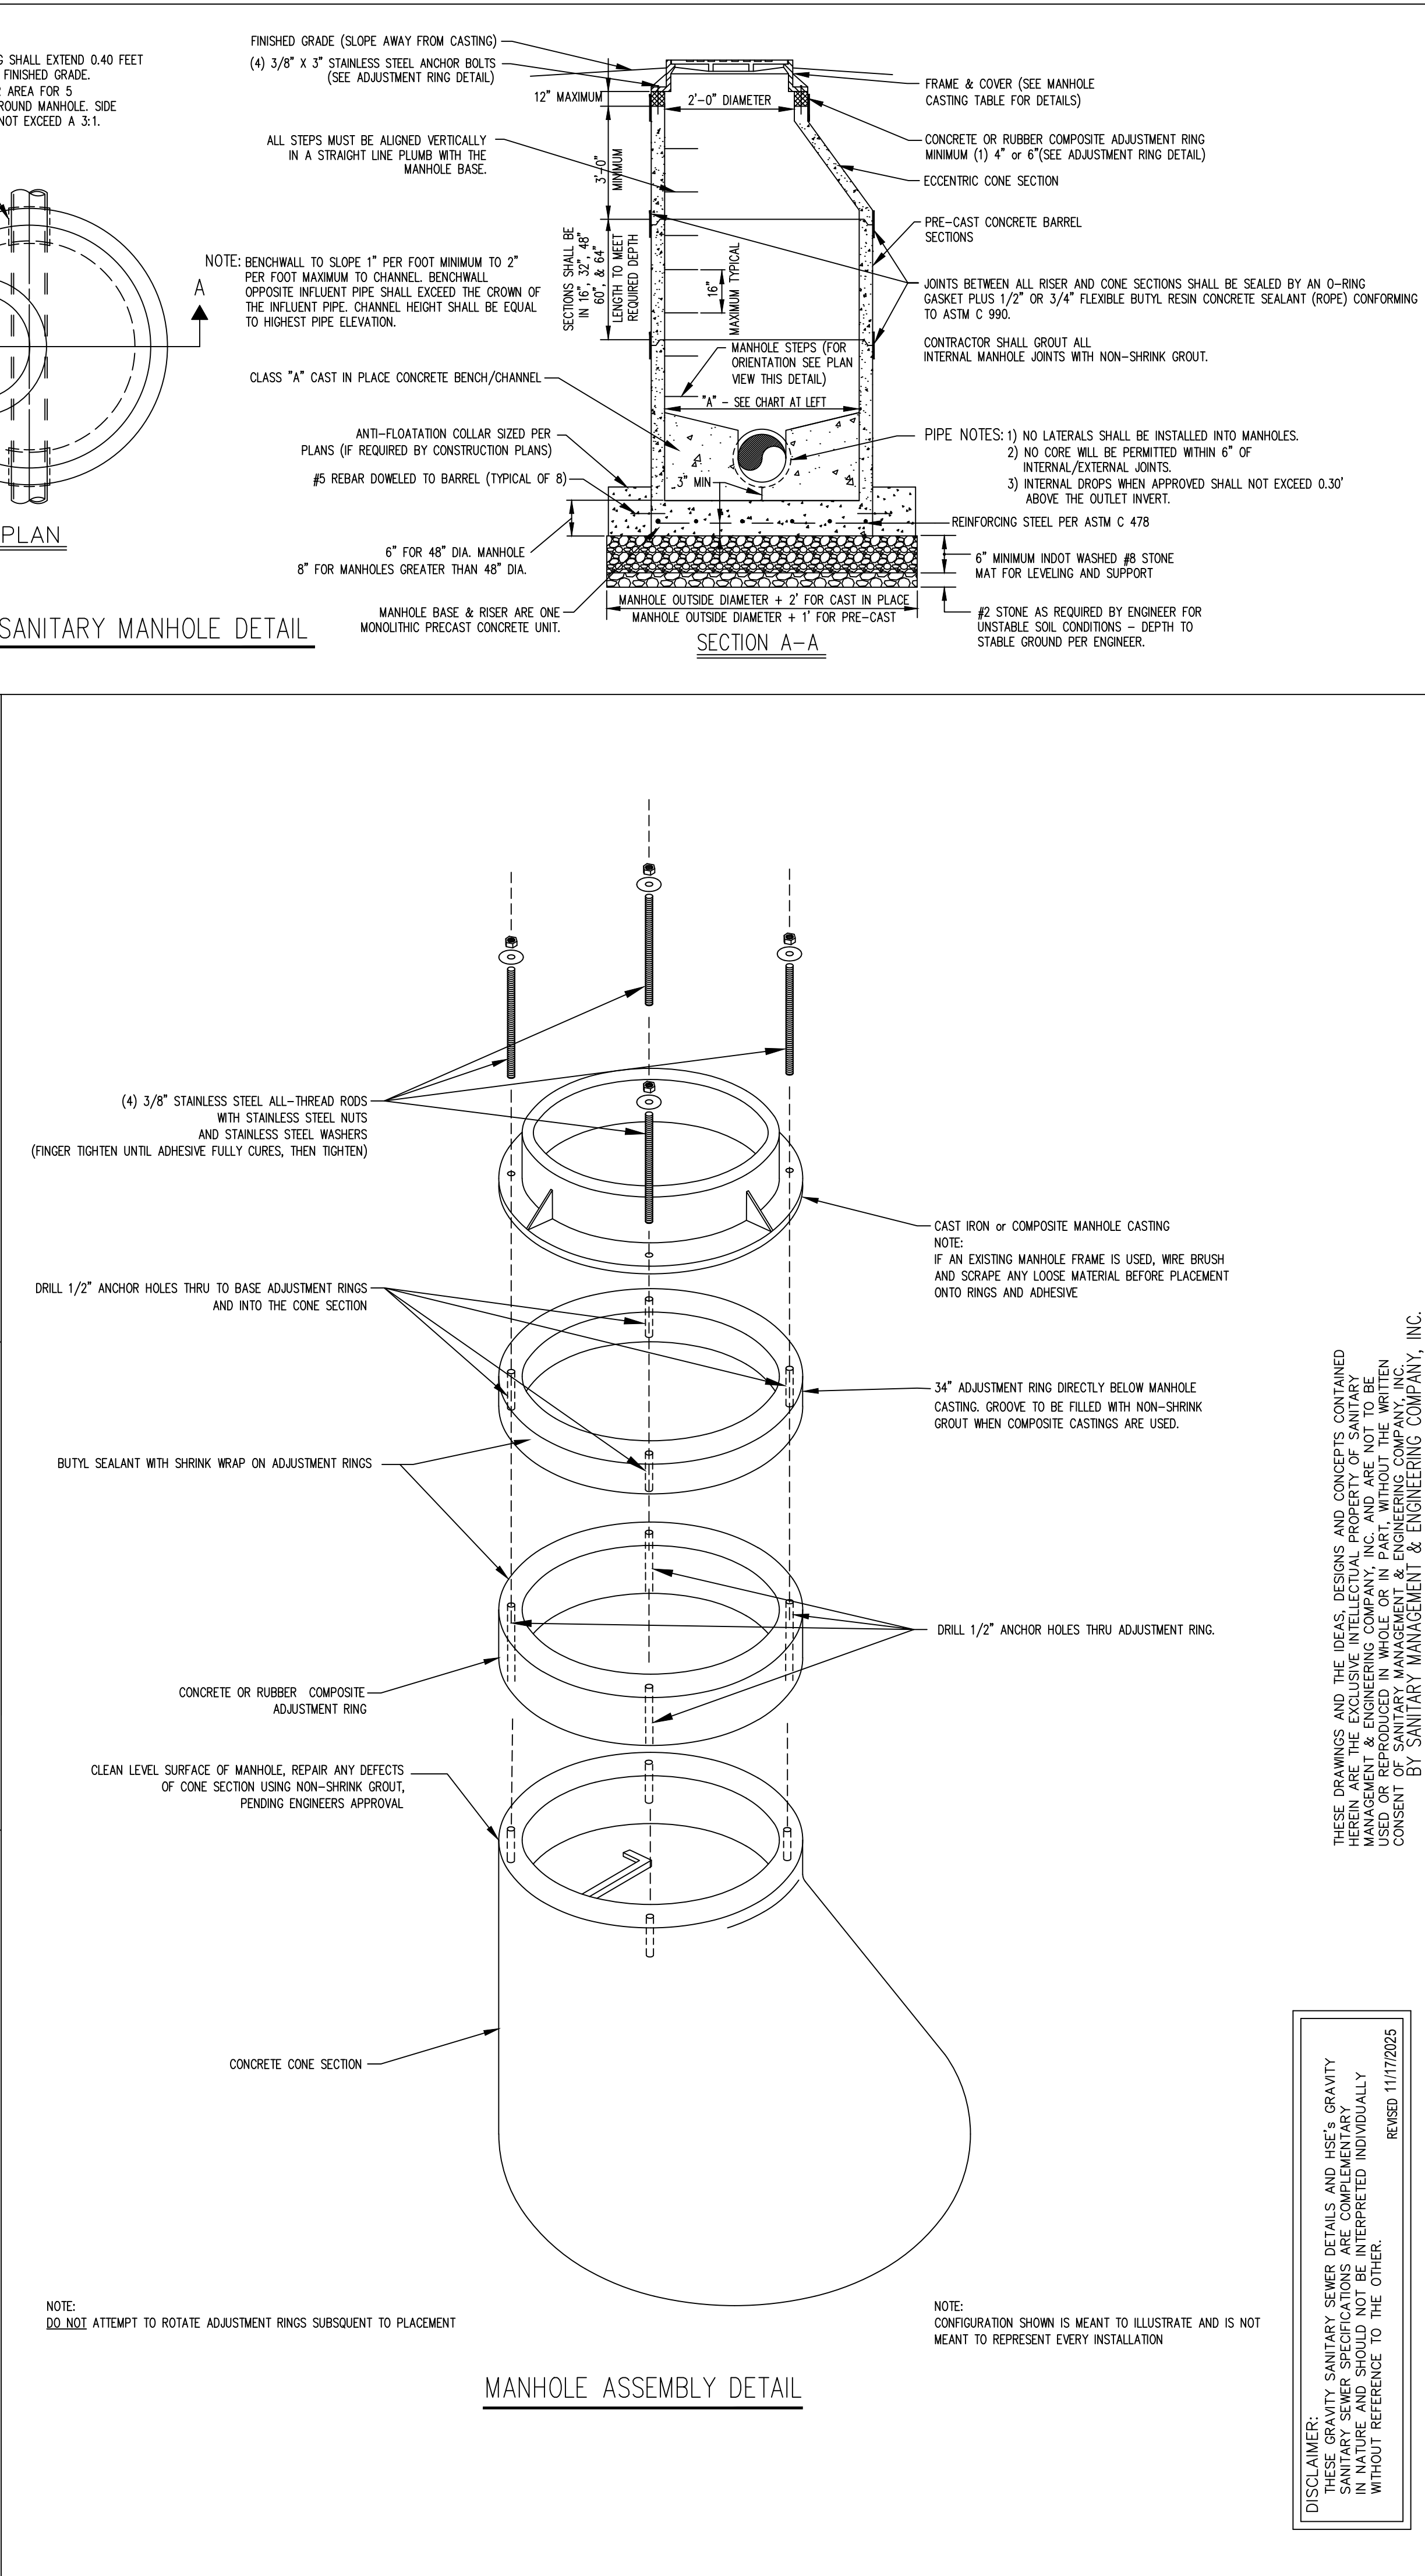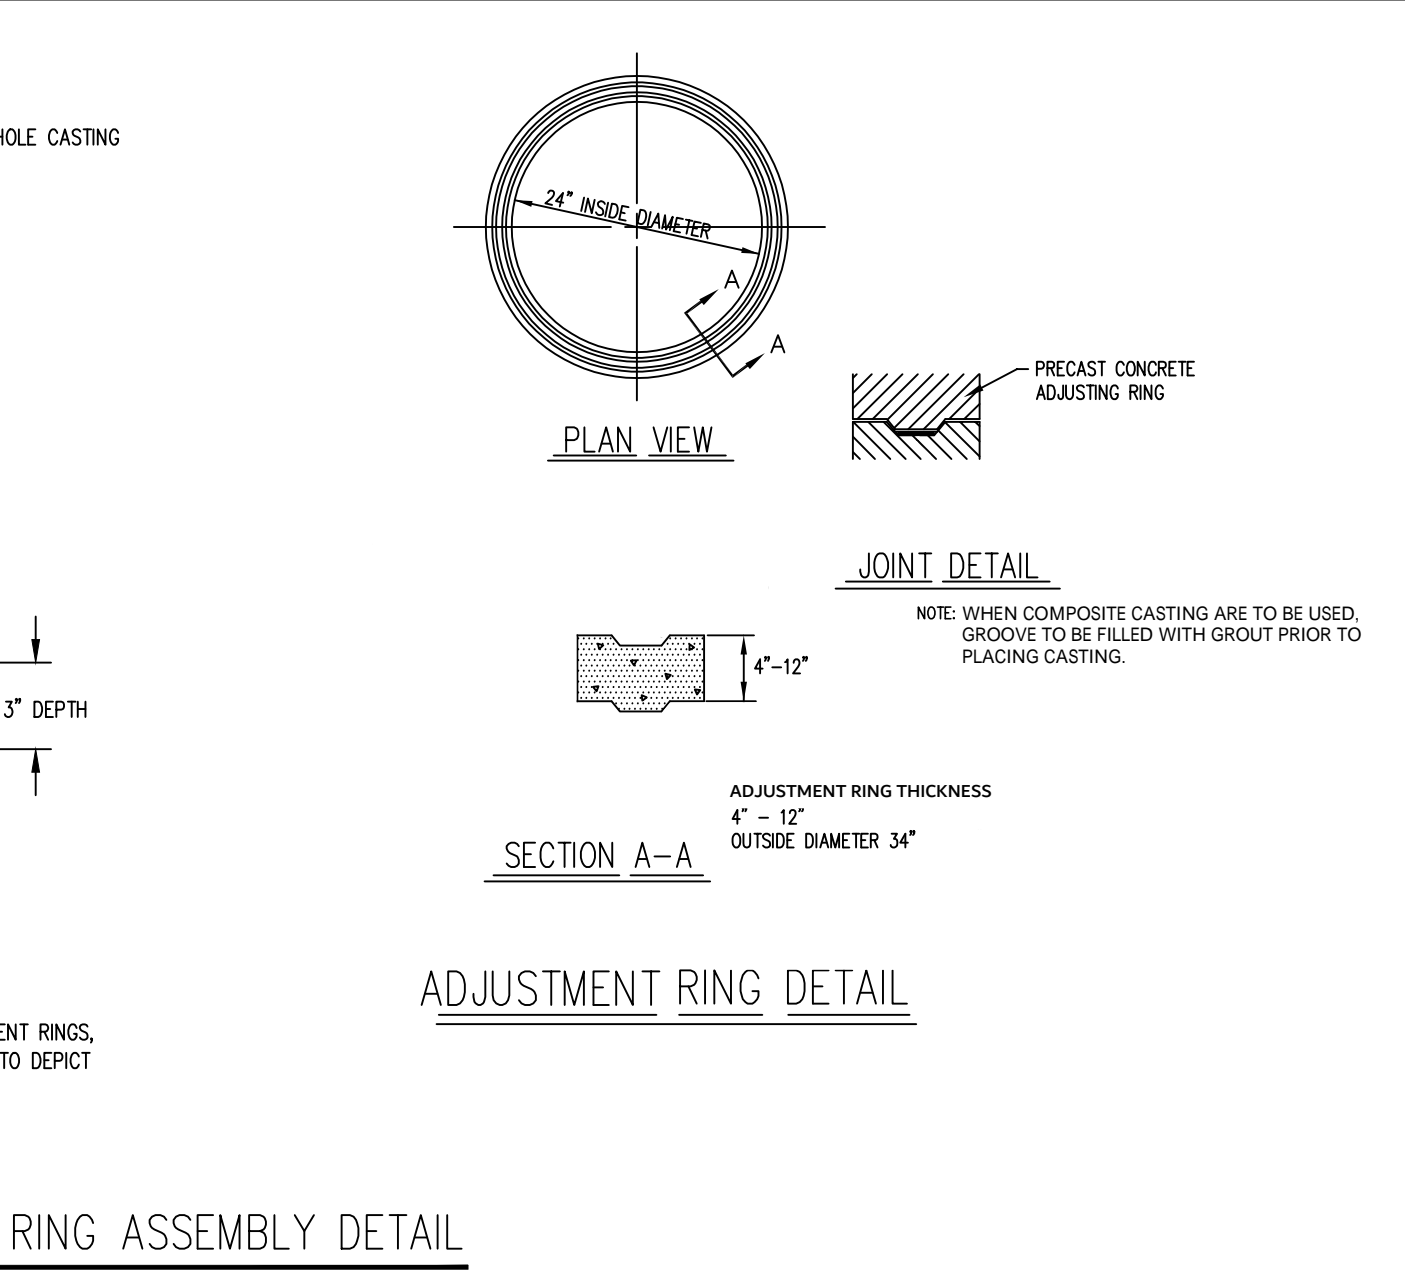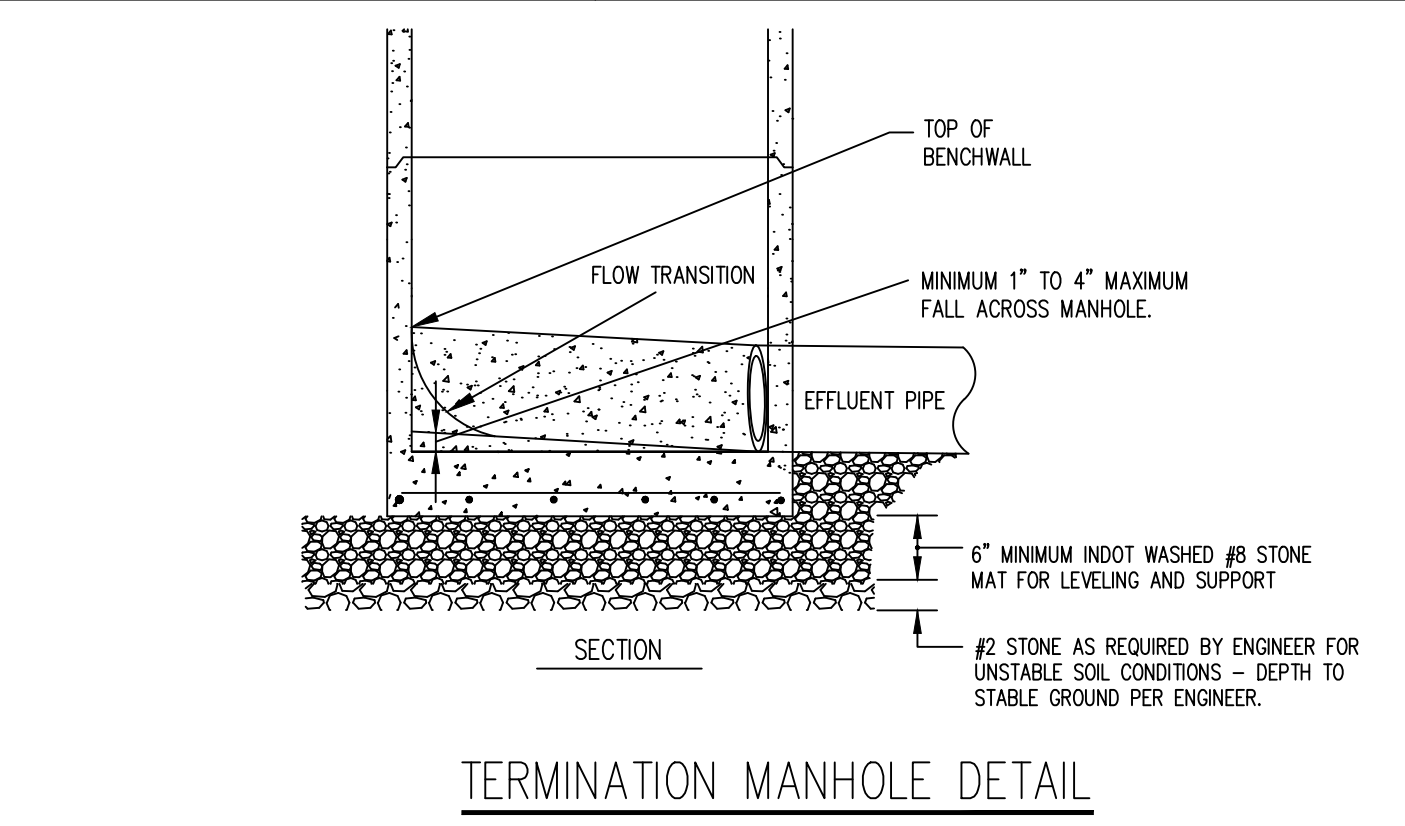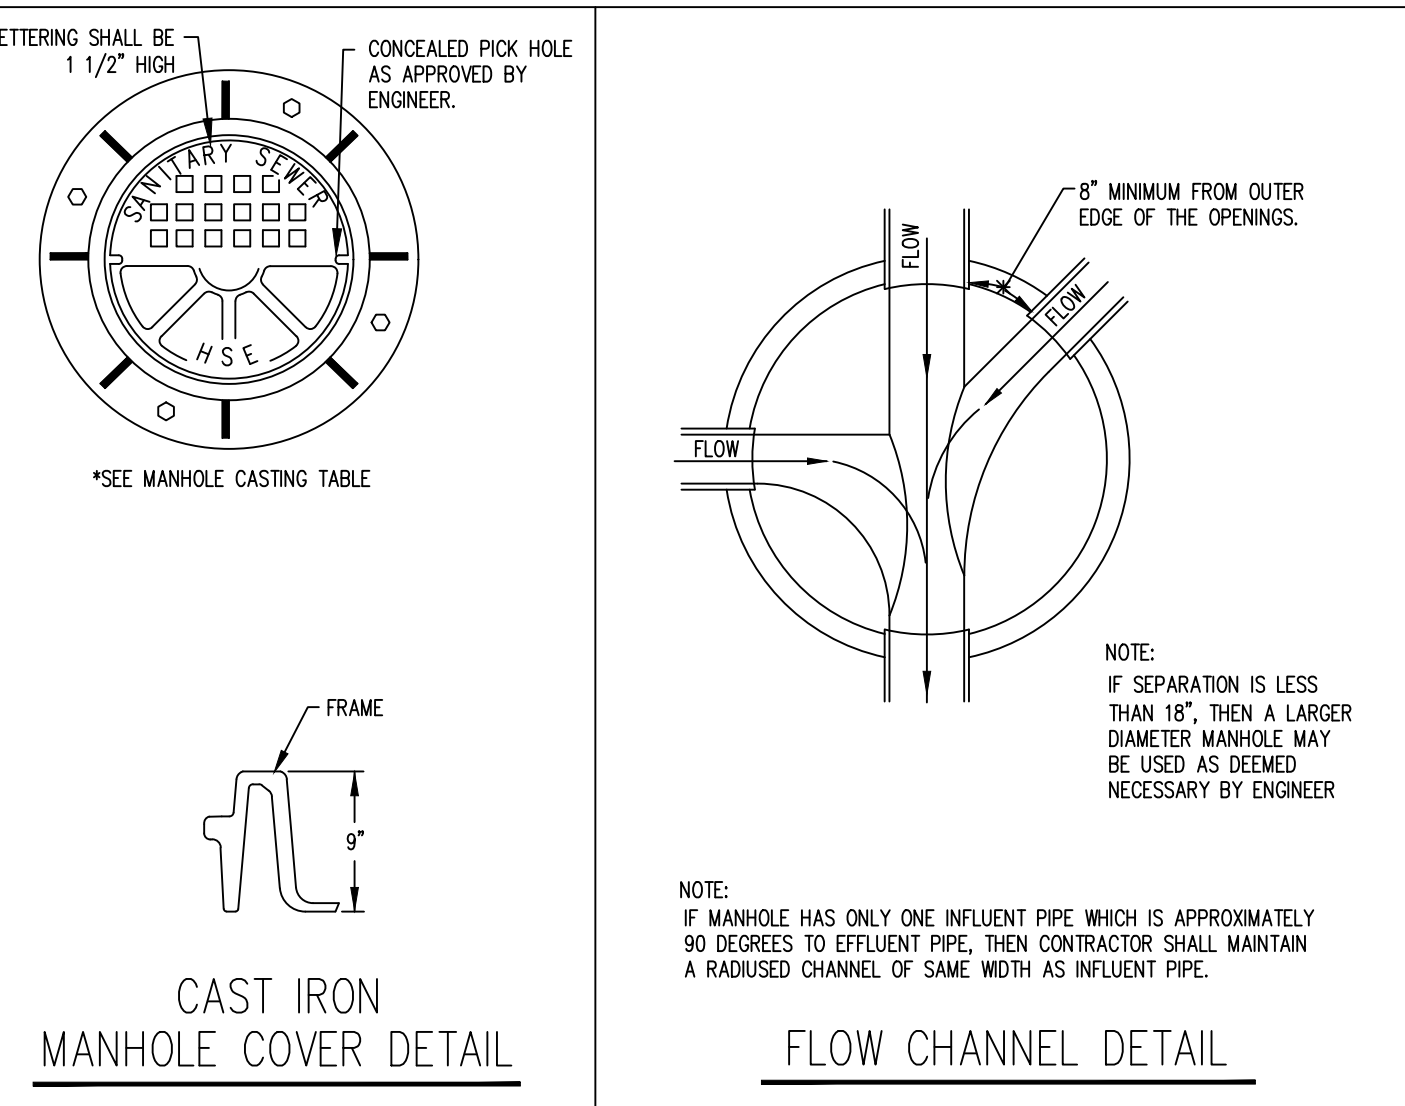

THESE DRAWINGS AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF SANITARY MANAGEMENT & ENGINEERING COMPANY, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF SANITARY MANAGEMENT & ENGINEERING COMPANY, INC. BY SANITARY MANAGEMENT & ENGINEERING COMPANY, INC.

DISCLAIMER:
THESE GRAVITY SANITARY SEWER DETAILS AND HSE's GRAVITY
SANITARY SEWER SPECIFICATIONS ARE COMPLEMENTARY
IN NATURE AND SHOULD NOT BE INTERPRETED INDIVIDUALLY
WITHOUT REFERENCE TO THE OTHER.

[illegible]